



PIPE DEPTH WITH DECLINING GRADE
AT EDGE OF PAVEMENT

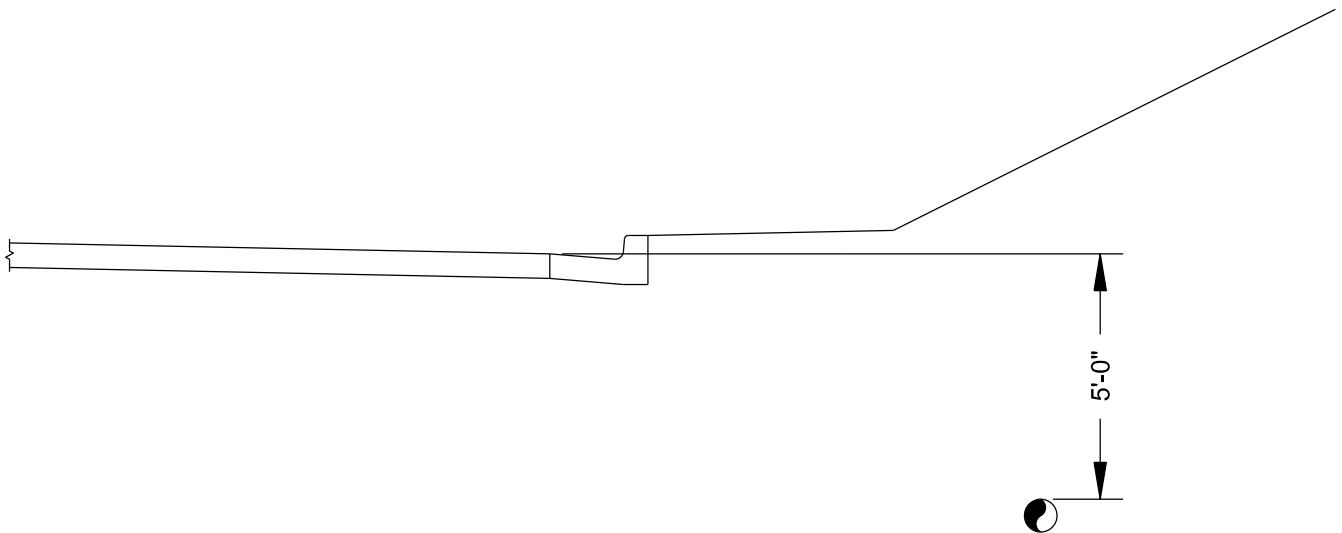

PIPE DEPTH WITH INCREASING GRADE
AT EDGE OF PAVEMENT

NOTES:

1. SANITARY SEWAGE FORCE MAINS SHALL HAVE A MINIMUM DEPTH OF COVER OF 5'-0" UNLESS OTHERWISE APPROVED BY HCWA.



HENRY COUNTY WATER AUTHORITY

**PIPE DEPTH AT
EDGE OF PAVEMENT**

REVISED: 09/11/2018

SCALE: N.T.S.

DETAIL NO.

S06