


30"x30"x4" THICK
3,000 PSI CONCRETE PAD
(UNPAVED LOCATIONS
ONLY)

24"x24"x4" THICK 3,000 PSI
CONCRETE PAD

ADJUSTABLE VALVE
BOX WITH COVER
MARKED "WATER"

FROST PROOF
YARD HYDRANT

3/4" HOSE CONNECTION
WITH VACUUM BREAKER,
WATTS NO. 80, OR EQUAL

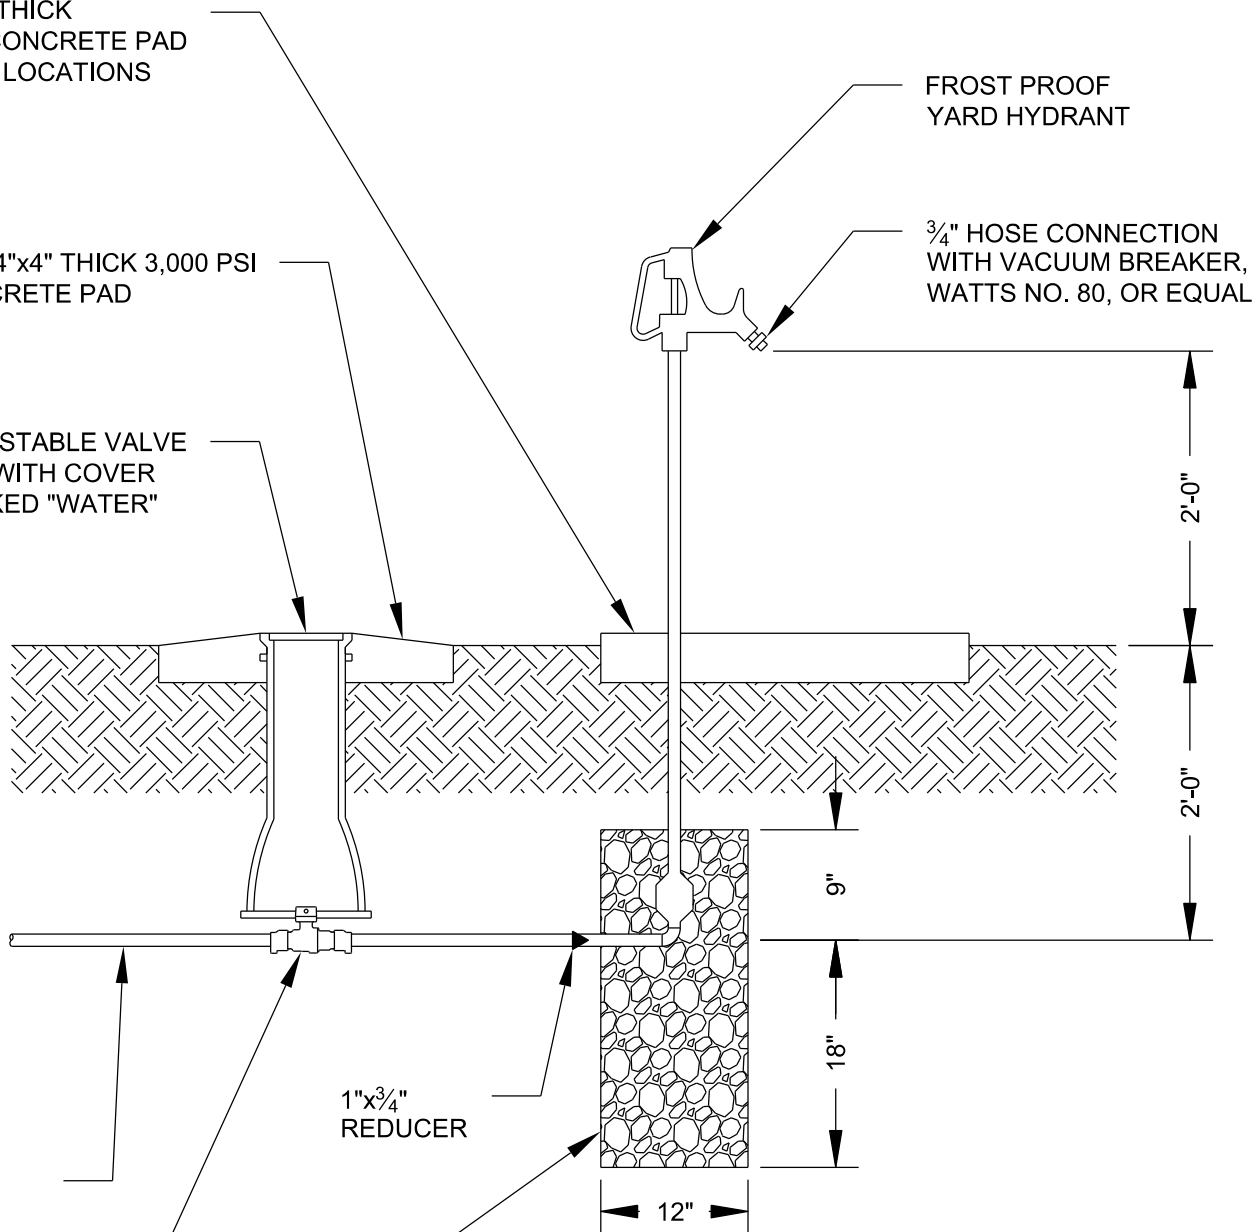

1" TYPE K
COPPER
SERVICE LINE

1" CTS COMP. x
CTS COMP.
CURB STOP

NO. 57
STABILIZATION
STONE

1"x3/4"
REDUCER

12"

9"

18"

2'-0"

2'-0"



HENRY COUNTY WATER AUTHORITY

FROST PROOF YARD HYDRANT

REVISED: 02/16/2018

SCALE: N.T.S.

DETAIL NO.

S32