


MORTAR SEAL (TYP.)

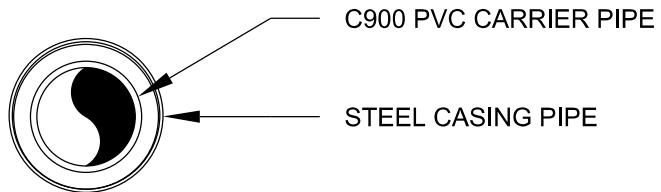

CARRIER PIPE NOMINAL DIAMETER (IN)	CASING PIPE NOMINAL DIAMETER (IN)	CASING PIPE THICKNESS (IN)
8	12	0.2500
10	16	0.2500
12	18	0.3130
16	24	0.3750

**NOTES:**

1. ENDS OF CASING PIPE SHALL BE SEALED WITH CEMENT MORTAR.
2. ALL COUNTY ROAD CROSSINGS SHALL BE INSTALLED IN ACCORDANCE WITH HENRY COUNTY DOT STANDARDS AND PERMIT REQUIREMENTS.
3. ALL STATE HIGHWAY CROSSINGS SHALL BE INSTALLED IN ACCORDANCE WITH GEORGIA DOT STANDARDS AND PERMIT REQUIREMENTS.
4. ALL RAILROAD CROSSINGS SHALL BE INSTALLED IN ACCORDANCE WITH AMERICAN RAILWAY ENGINEERING ASSOCIATION REGULATIONS AND IN ACCORDANCE WITH PERMIT REQUIREMENTS.



HENRY COUNTY WATER AUTHORITY

# TYPICAL JACK AND BORE DETAIL SANITARY SEWER FORCE MAIN

REVISED: 09/14/2018

SCALE: N.T.S.

DETAIL NO.

## S37