



ALTERNATE CONFIGURATIONS

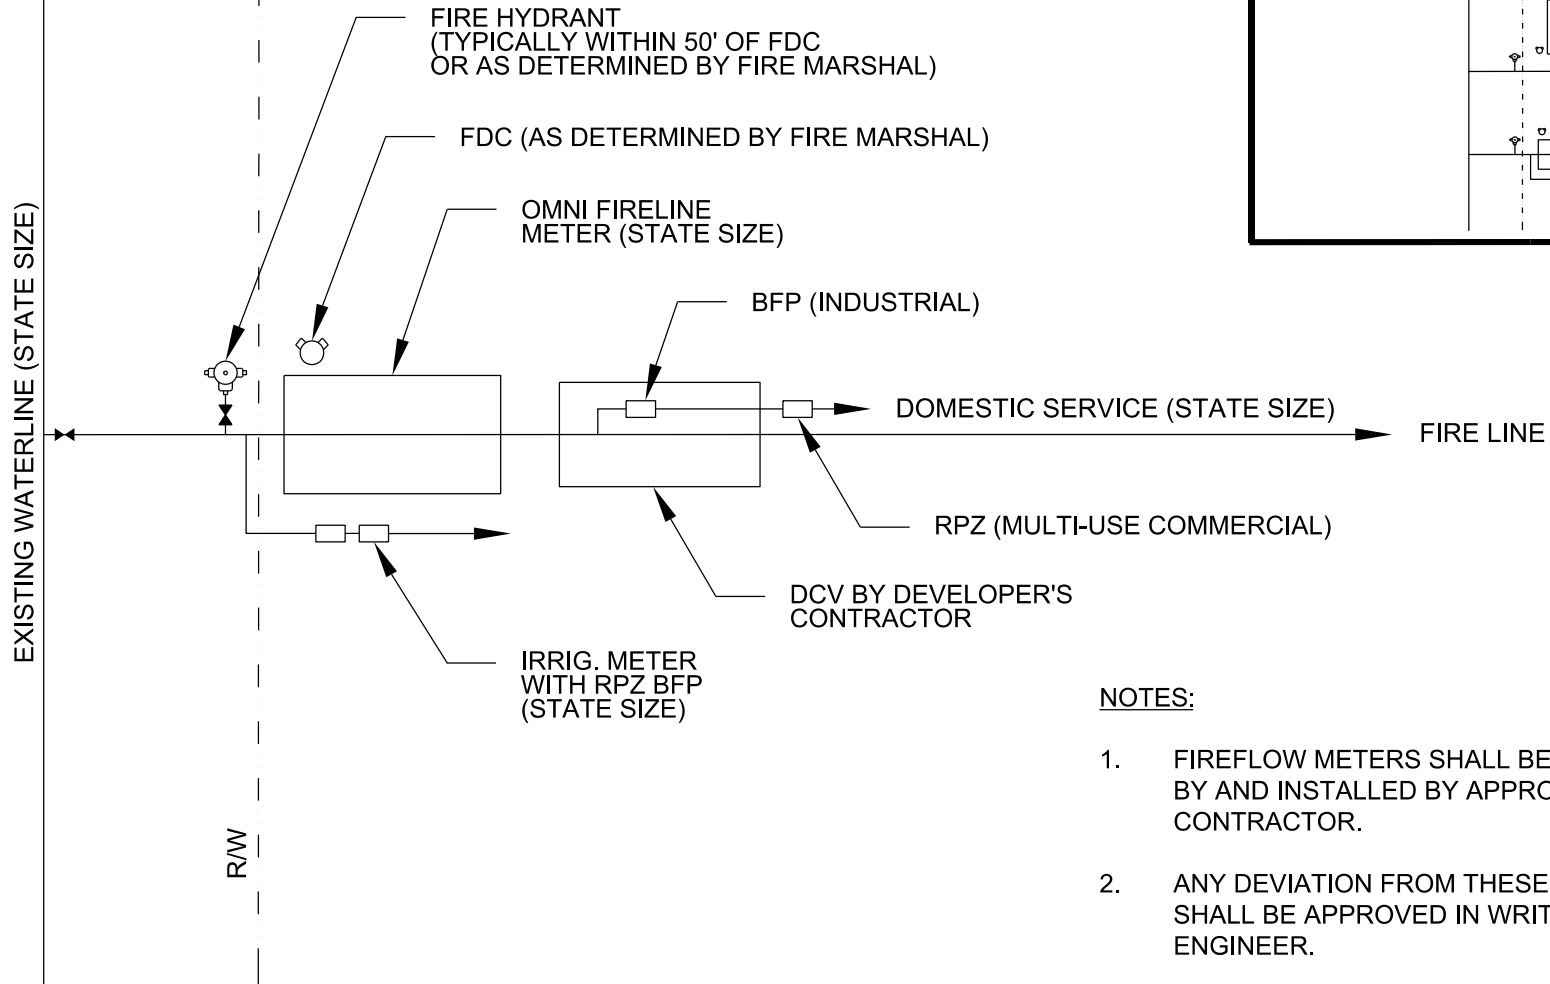

NOTES:

1. FIREFLOW METERS SHALL BE PROVIDED BY AND INSTALLED BY APPROVED LICENSED CONTRACTOR.
2. ANY DEVIATION FROM THESE STANDARDS SHALL BE APPROVED IN WRITING BY THE HCWA ENGINEER.

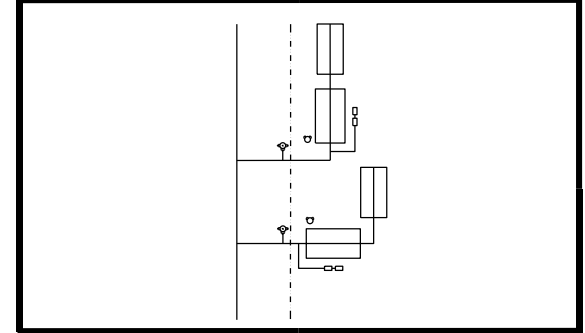

HENRY COUNTY WATER AUTHORITY

TYPICAL COMMERCIAL / INDUSTRIAL METER CONFIGURATIONS

REVISED: 09/14/2018

SCALE: N.T.S.

DETAIL NO.

W24